


WATER SUPPLY AND WASTE WATER REPORTING HAVE REPORT TO BE STATIONS - NEARBY WATER CURE - HEAT STATION - POWER AND LIGHTS (E.C. 22 HOURS AND 30 MIN) IN 1900 - 700' C.P.L. PIPE - 200' ON EACH OF STREETS - 100' C.P.L. PIPE WITH RISE IN FRONT OF BLDG NO. 2 - TWO 100' TANK CHIMES - INSULATED RAIL ONE END - DIMENSIONED UNDER STAIR - MONTHLY - RAIN SPRINKLERS THROUGH BLDG NO. 1 - 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25 - ALL OTHER BLDGS IN PHASE OF BLDG NO. 10 - DIMENSIONED - DAY SYSTEM IN B.C.C. J.M. II. 17 & 18 - OTHERS NOT DIMENSIONED SINCE B.C.C. ACCEPT E. WHEEL SHOP AND 17 & 18 - DIMENSIONED PER 100' MIN. & BUFFALO STEAM PUMP & BURNER CAPAC. 200 GALS PER MIN. DRAWING FROM 100'000 GALS. RESERVOIR SUPPLIED BY THE C. TOWN TO CITY - PROVISION 65' TO 75' 145'

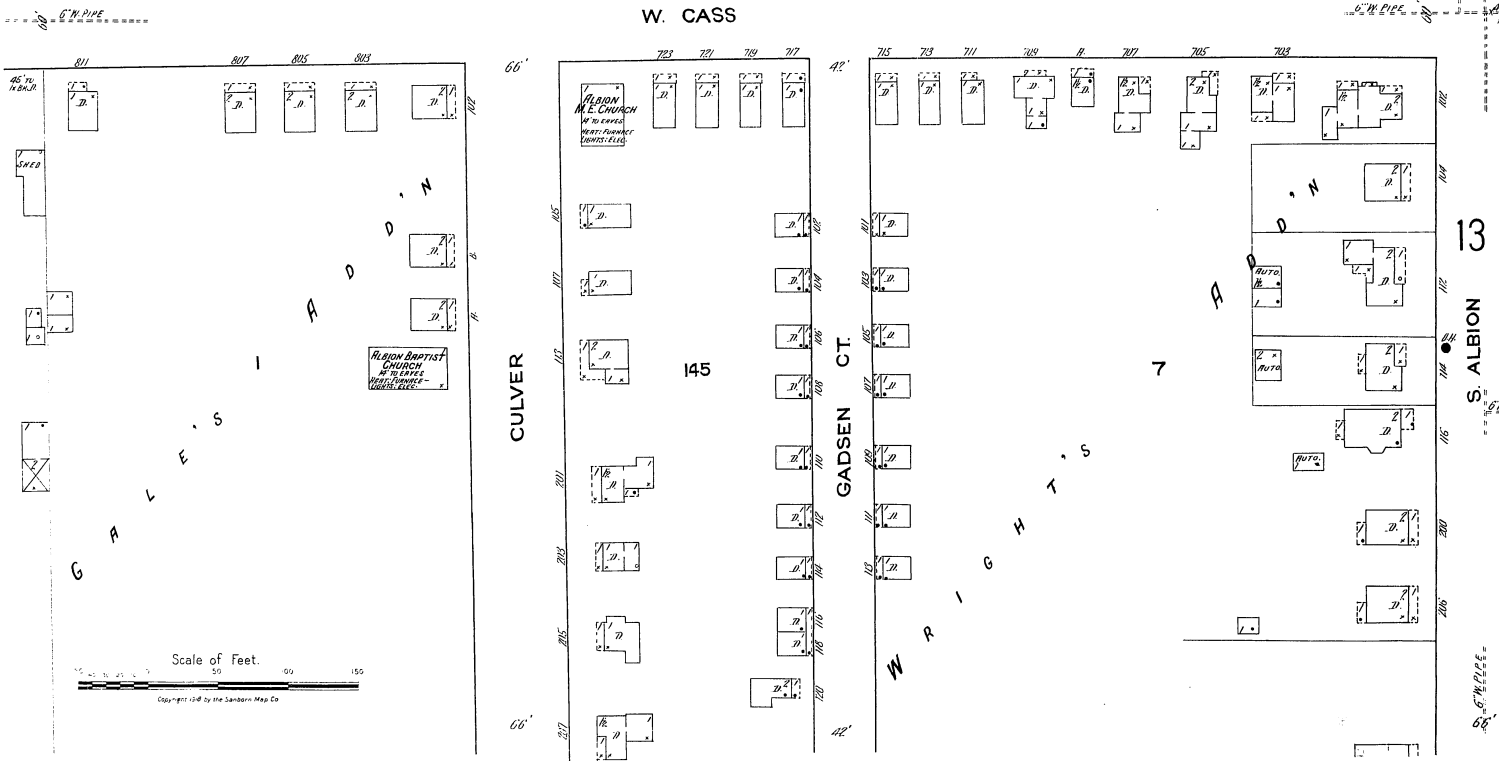

Scale of Feet. 0 50 100 150

Copyright 1918 by the Standard Map Co.